

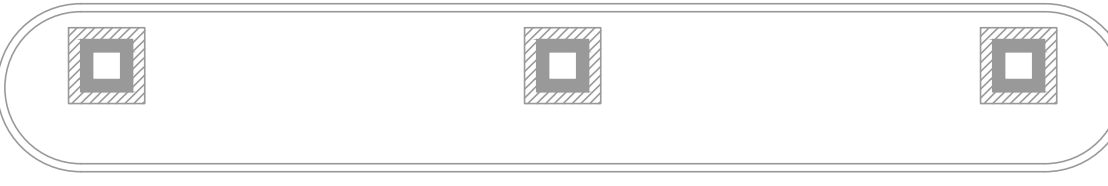


Reviewed for Code Compliance
 2015 IBC, IMC, IPC 2017 NEC 2015 IECC
 Zac Loiseau I-2642
 Subject to Field Inspections

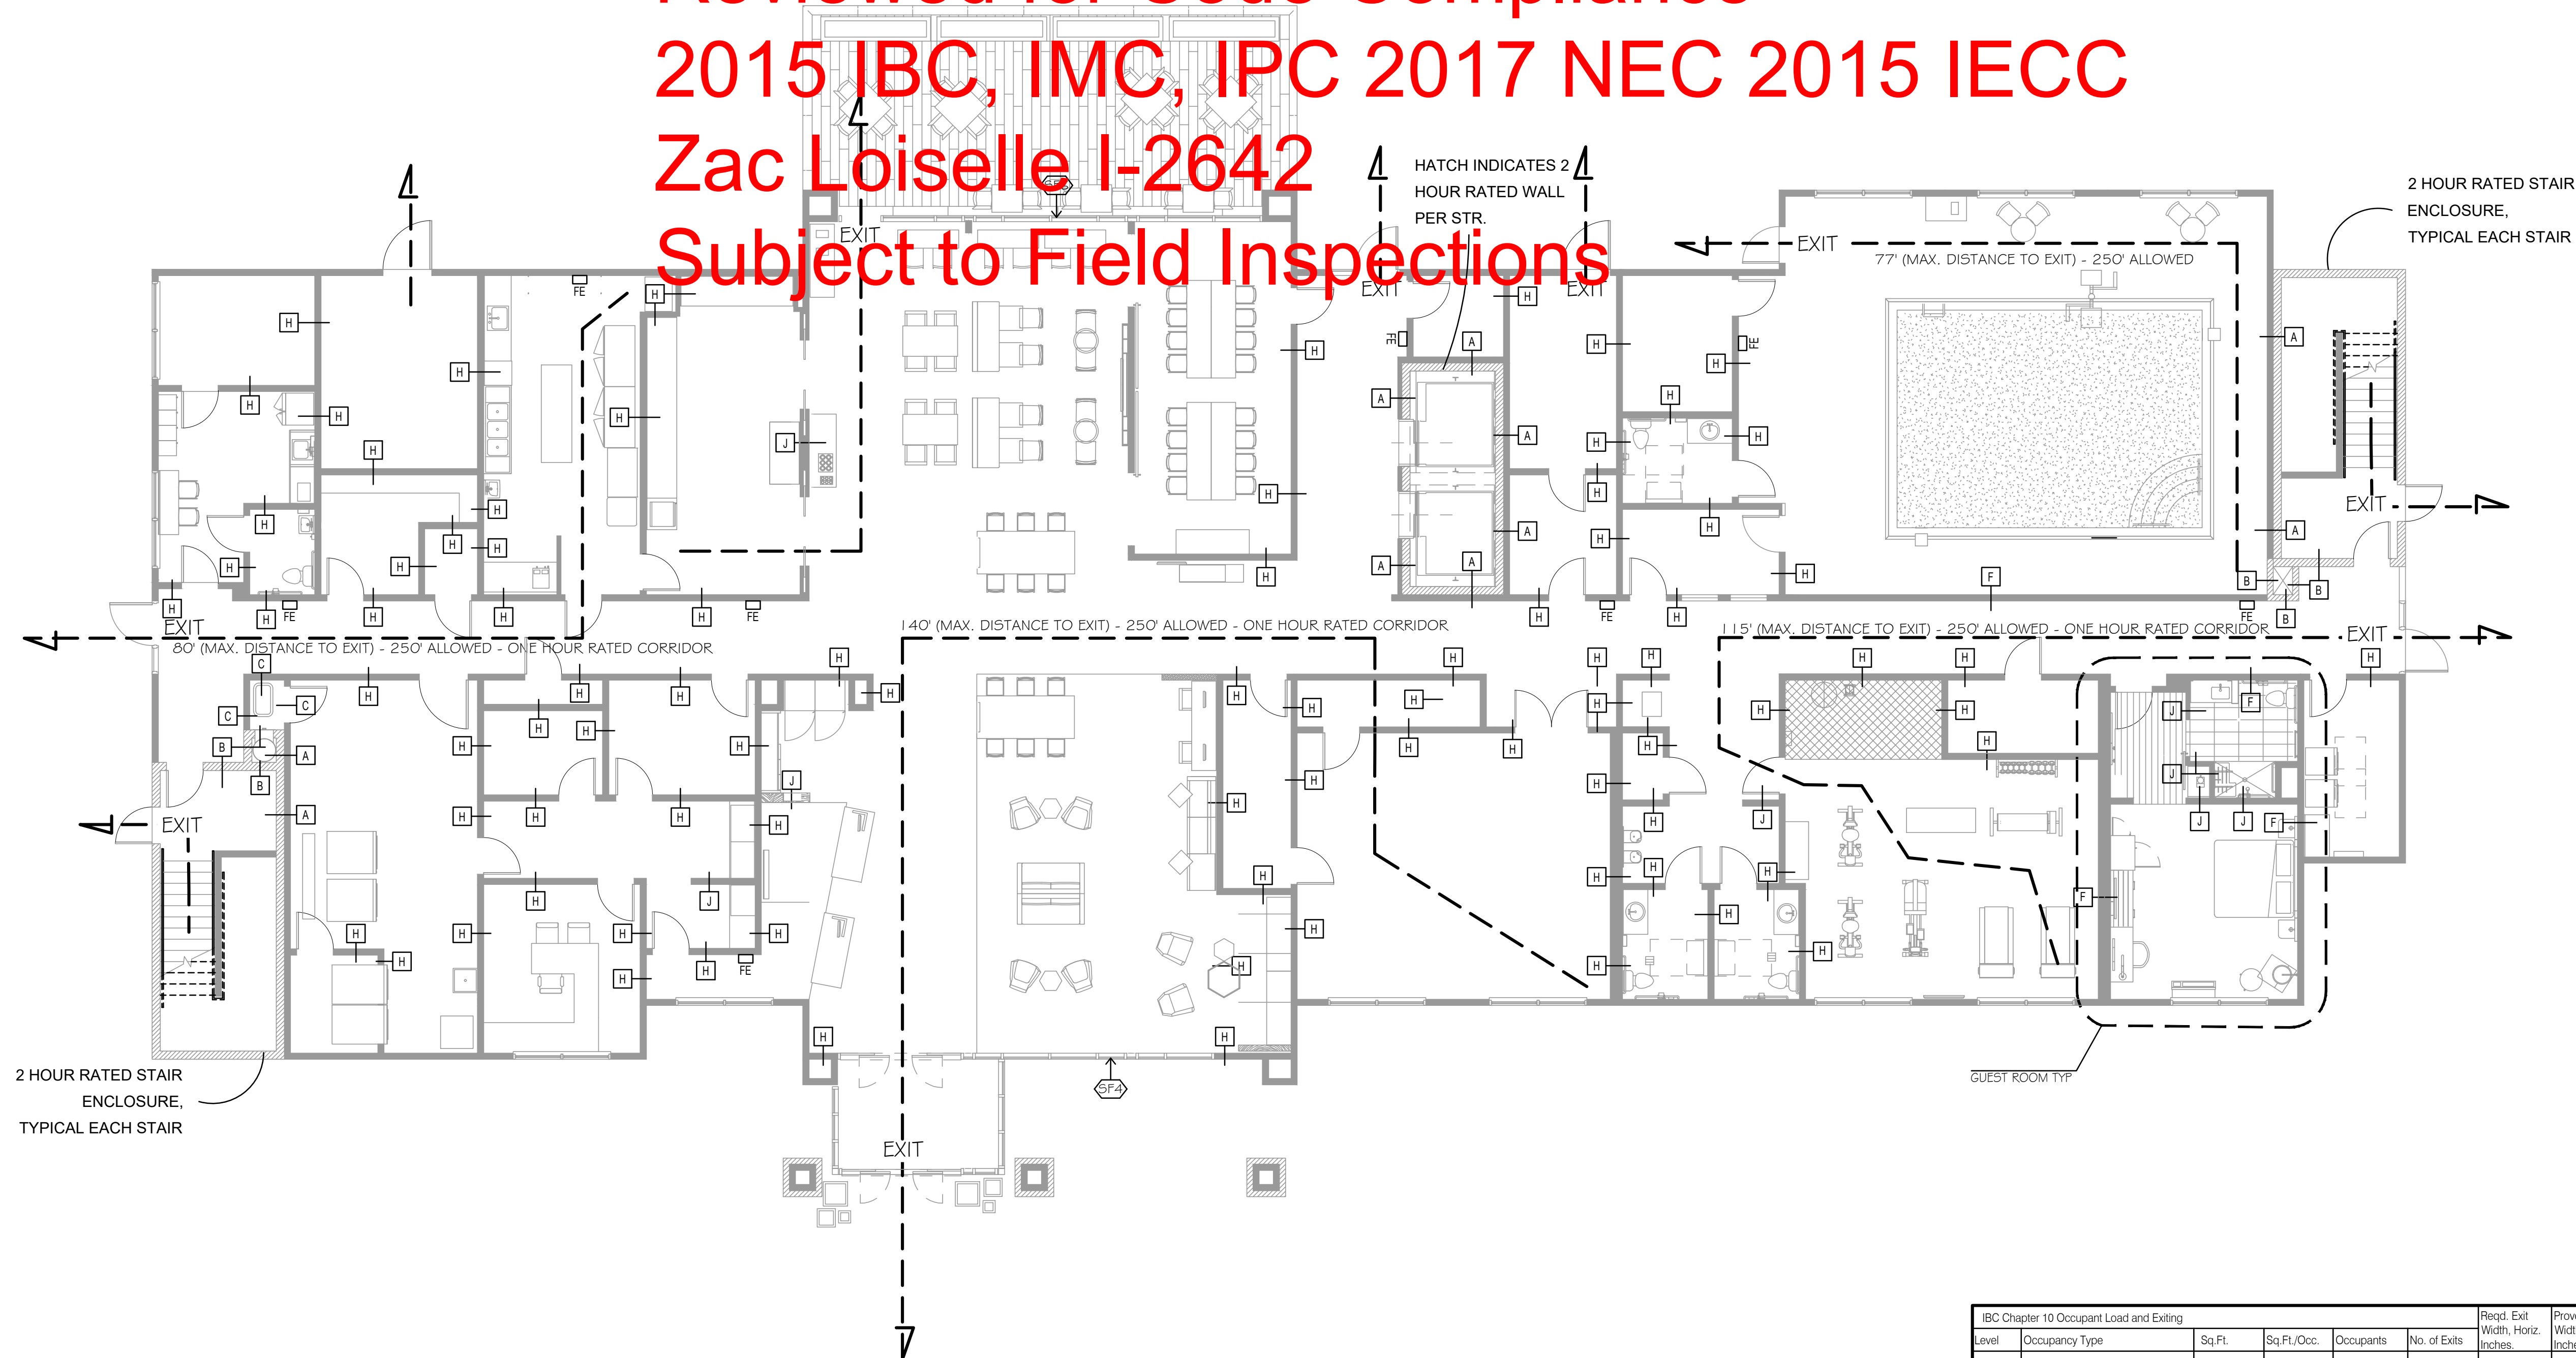

1 FIRST FLOOR EGRESS PLAN
 SCALE: 1/8" = 1'-0"

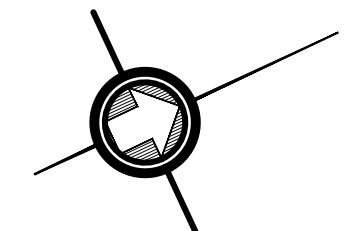

IBC Chapter 10 Occupant Load and Exiting						Reqd. Exit Width, Horiz. Inches	Provid. Exit Width, Horiz. Inches	Reqd. Exit Width, Vert. Inches	Provid. Exit Width, Vert. Inches
Level	Occupancy Type	Sq. Ft.	Sq. Ft./Occ.	Occupants	No. of Exits				
Level 1	R1 Residential, Hotel	1,006	200	5.03					
	A2 Assembly Lobby / Breakfast	3,938	15	262.53					
	A3 Fitness Center	825	15	55					
	B Business Office	3046	50	60.92					
	B Business Office	3186	100	31.86					
	B Incidental used, max 10% (1,228)					0.2' per Occupant		0.3' per Occupant	
	Total First Floor	12,001		412.35	6	82.47	216	Exit at Grade	Exit at Grade
Level 2	R1 Residential, Hotel.	11,746	200	58.73	2	11.74	72	21.6	96
Level 3	R1 Residential, Hotel.	11,746	200	58.73	2	11.74	72	21.6	96
Level 4	R1 Residential, Hotel.	11,746	200	58.73	2	11.74	72	21.6	96

