

NOTE:
 - Strength work and cardio work zones must have different flooring in fitness centers larger than 46.5m² (500ft²) [1 | 25 | 1 G]
 - Strength areas must have cushioned flooring in fitness centers 46.5m² (500ft²) and larger [1 | 25 | 17] (This is the Carpet Tile - EXP-CPT3.2.)
 - Cardio areas must not use cushioned flooring [1 | 25 | 18] (Provide the vinyl flooring only (EXP-VF3.1 / Durkan).)
 SUBMIT FITNESS EQUIPMENT PLAN FROM IHG APPROVED VENDOR PRIOR TO CONSTRUCTION.

Reviewed for Code Compliance
 2015 IBC, IMC, IPC 2017 NEC 2015 IECC
 Zac Loiseau I-2642
 Subject to Field Inspections


NOTE: PRIOR TO CONSTRUCTION OF BREAKFAST PANTRY AND GREAT ROOM, VERIFY POWER AND PLUMBING REQUIREMENTS FOR REQUIRED EQUIPMENT. NOTIFY ARCHITECT OR ENGINEER IF REVISIONS ARE REQUIRED.

NOTE: PROVIDE SPLASH GUARDS AT ALL HAND WASH SINKS, TYPICAL.

GENERAL CONTRACTOR TO VERIFY ALL ELEVATOR SHAFT DIMENSIONS WITH ELEVATOR MANUFACTURER PRIOR TO CONSTRUCTION. COORDINATE WITH STRUCTURAL AS REQUIRED.

PROVIDE THE EXPRESS SHOP SIGN

OPEN BELOW INSULATE PIPES

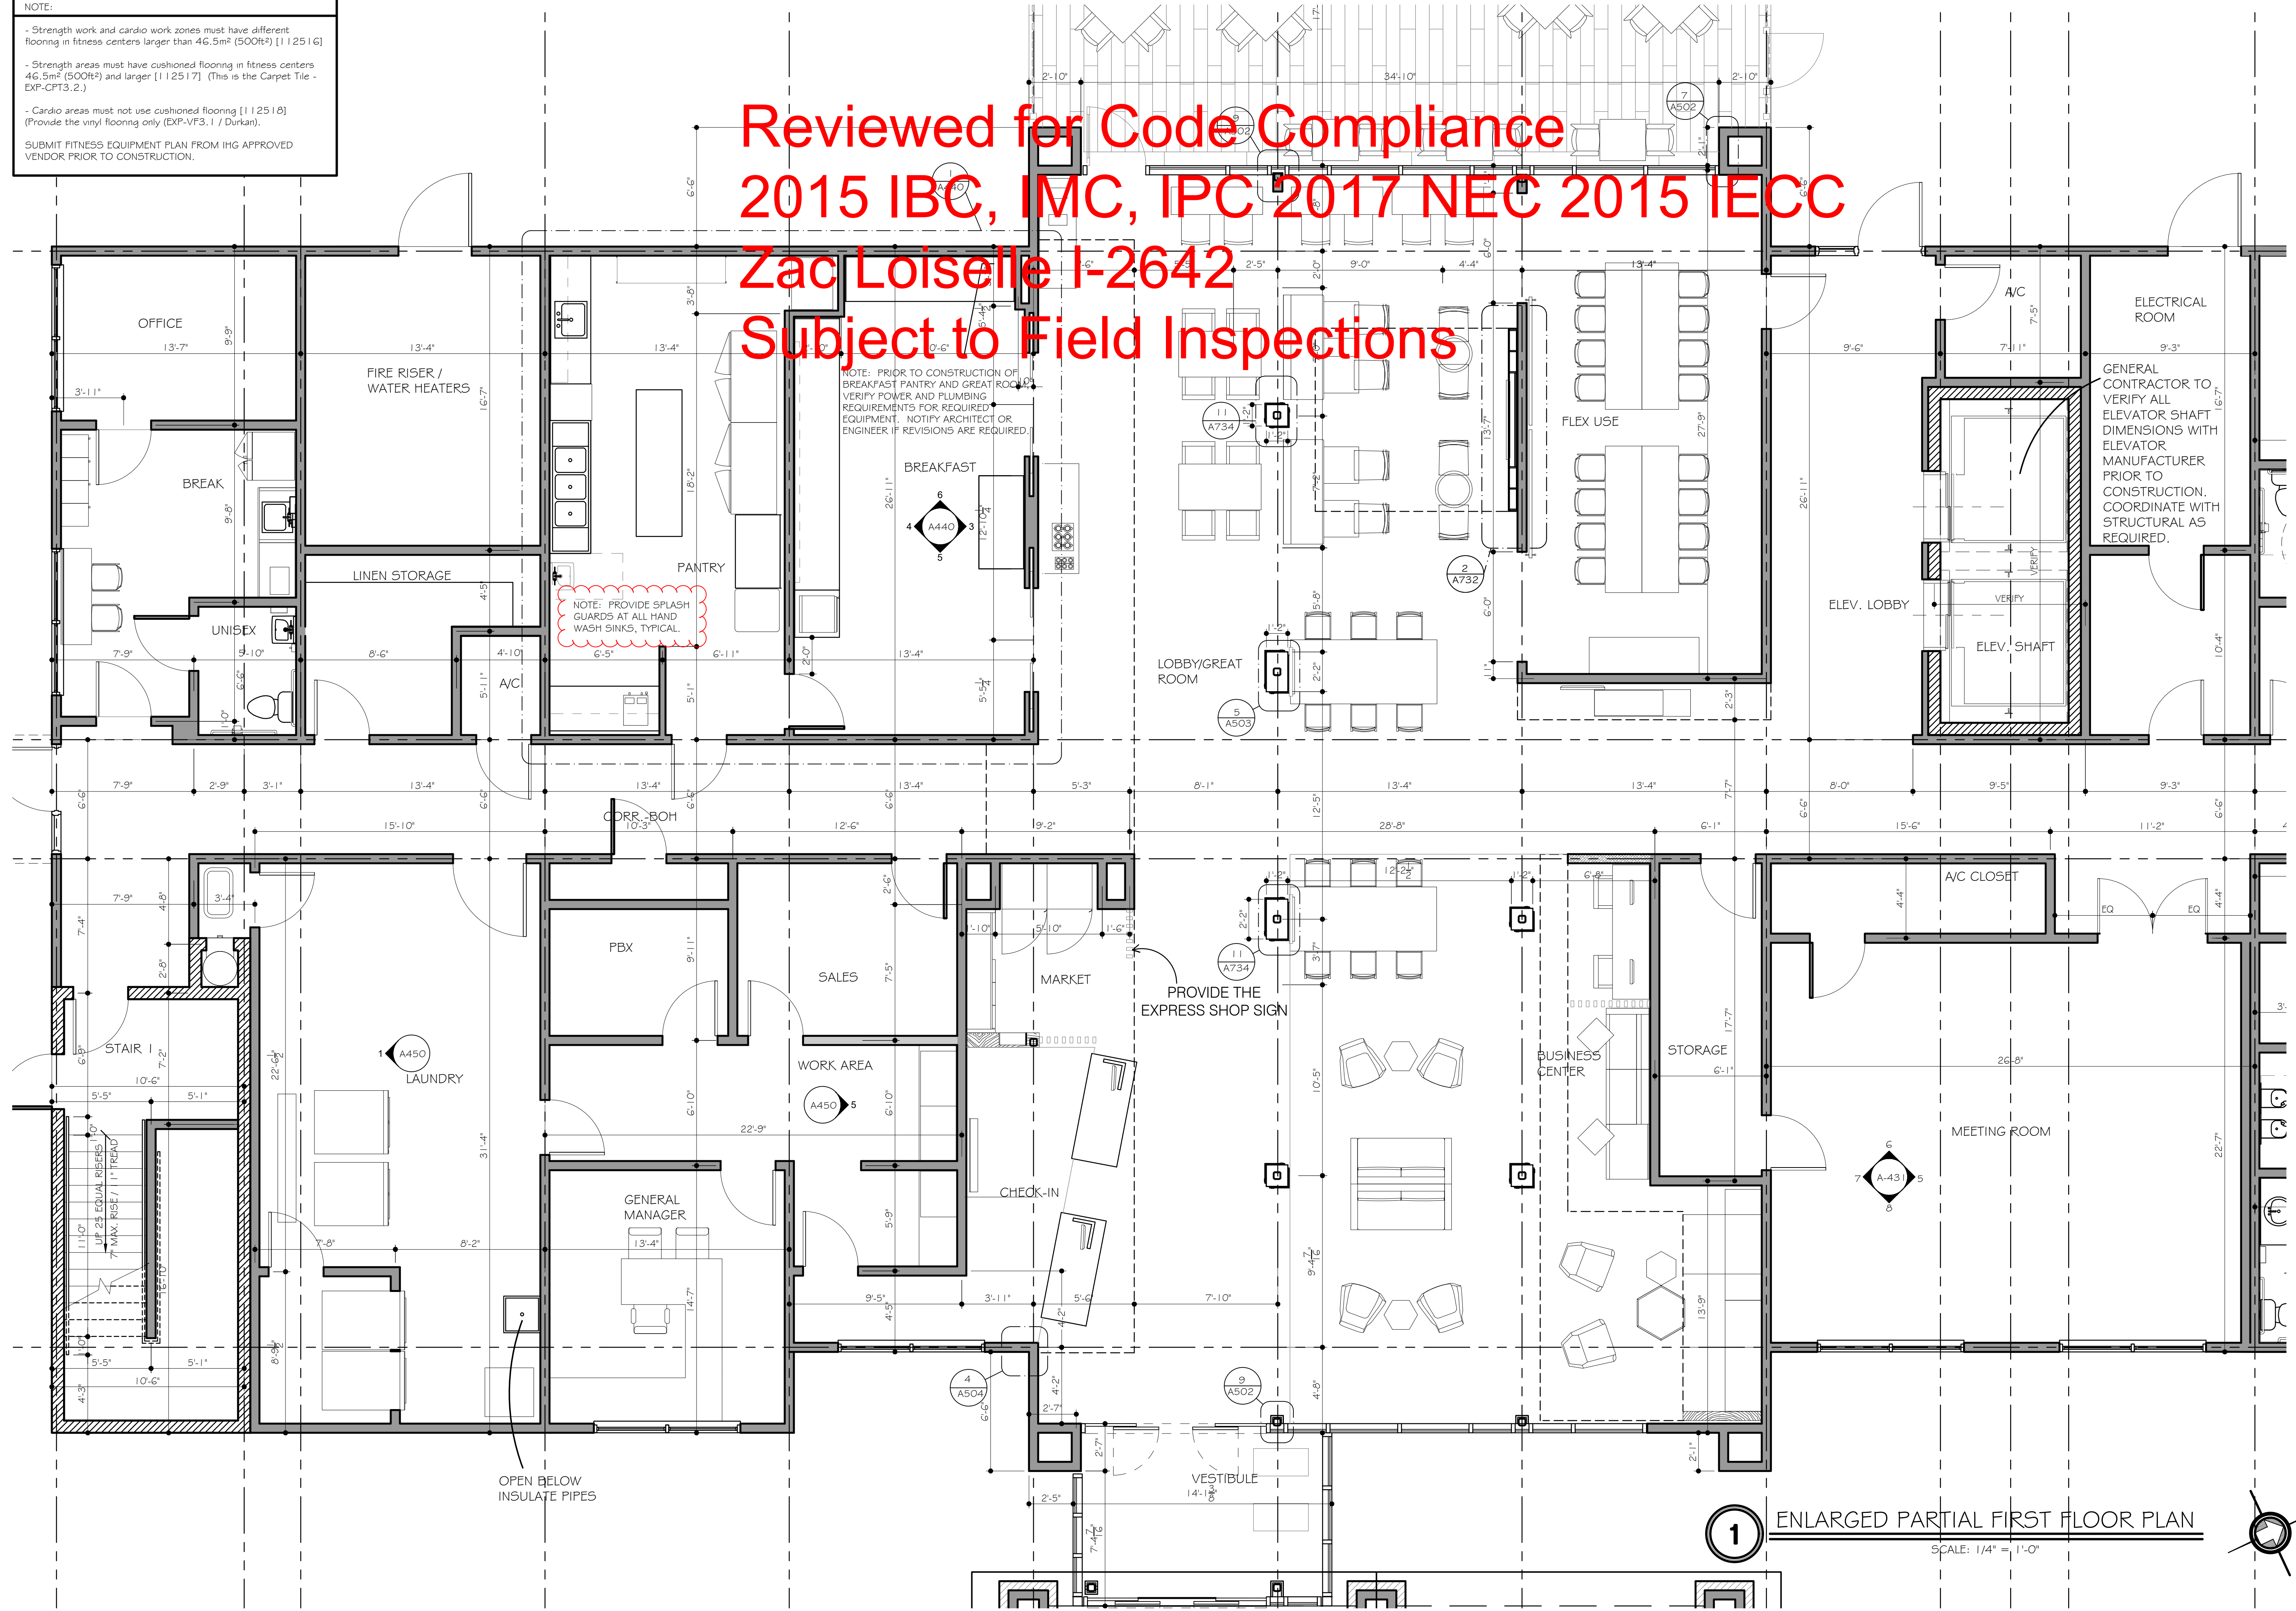


1 ENLARGED PARTIAL FIRST FLOOR PLAN
 SCALE: 1/4" = 1'-0"

REVISION NO.

HOLIDAY INN EXPRESS
 850 NORTHSIDE DRIVE
 PILOT POINT, TEXAS 76258

LOCATION
 91024

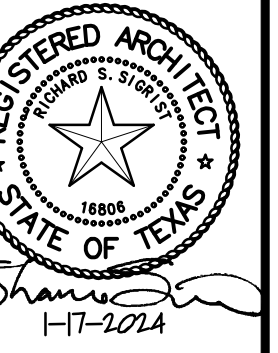

RSS architects LLC
 RSS-ARCHITECTS.COM
 817/538-9258

Date 1-17-2024

Job 22020

Sheet

A-401