



REVISION	NO.
CITY COMMENTS	1

HOLIDAY INN EXPRESS
 850 NORTHSIDE DRIVE
 PILOT POINT, TEXAS 76258

LOCATION
 91024

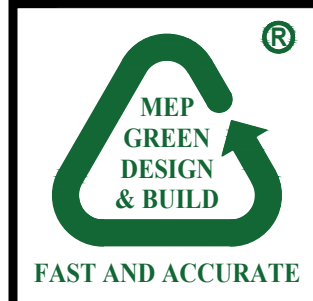

FAST AND ACCURATE
 JAN. 08, 2024
 REGISTERED PROFESSIONAL ENGINEER
 MEP GREEN DESIGN & BUILD, P.L.L.C.
 REGISTRATION # F-10992
 915 GEMIN ST, HOUSTON, TX 77058
 TEL: (281)-786-1155
 FAX: (281)-282-9144
 WWW.MEPGREENDESIGNS.COM

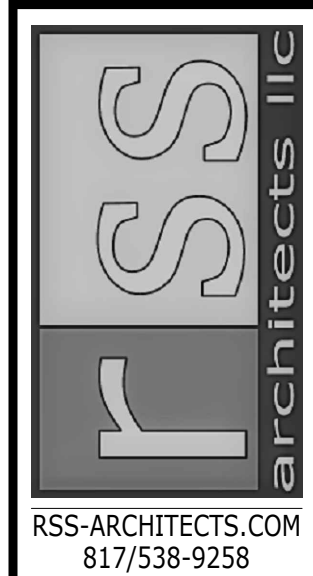

RSS-ARCHITECTS.COM
 817/538-9258


Date 01-08-2024

Job 22020

Sheet

P2. □

Reviewed for Code Compliance
2015 IBC, IMC, IPC 2017 NEC 2015 IECC
Zac Loiseau I-2642
Subject to Field Inspections

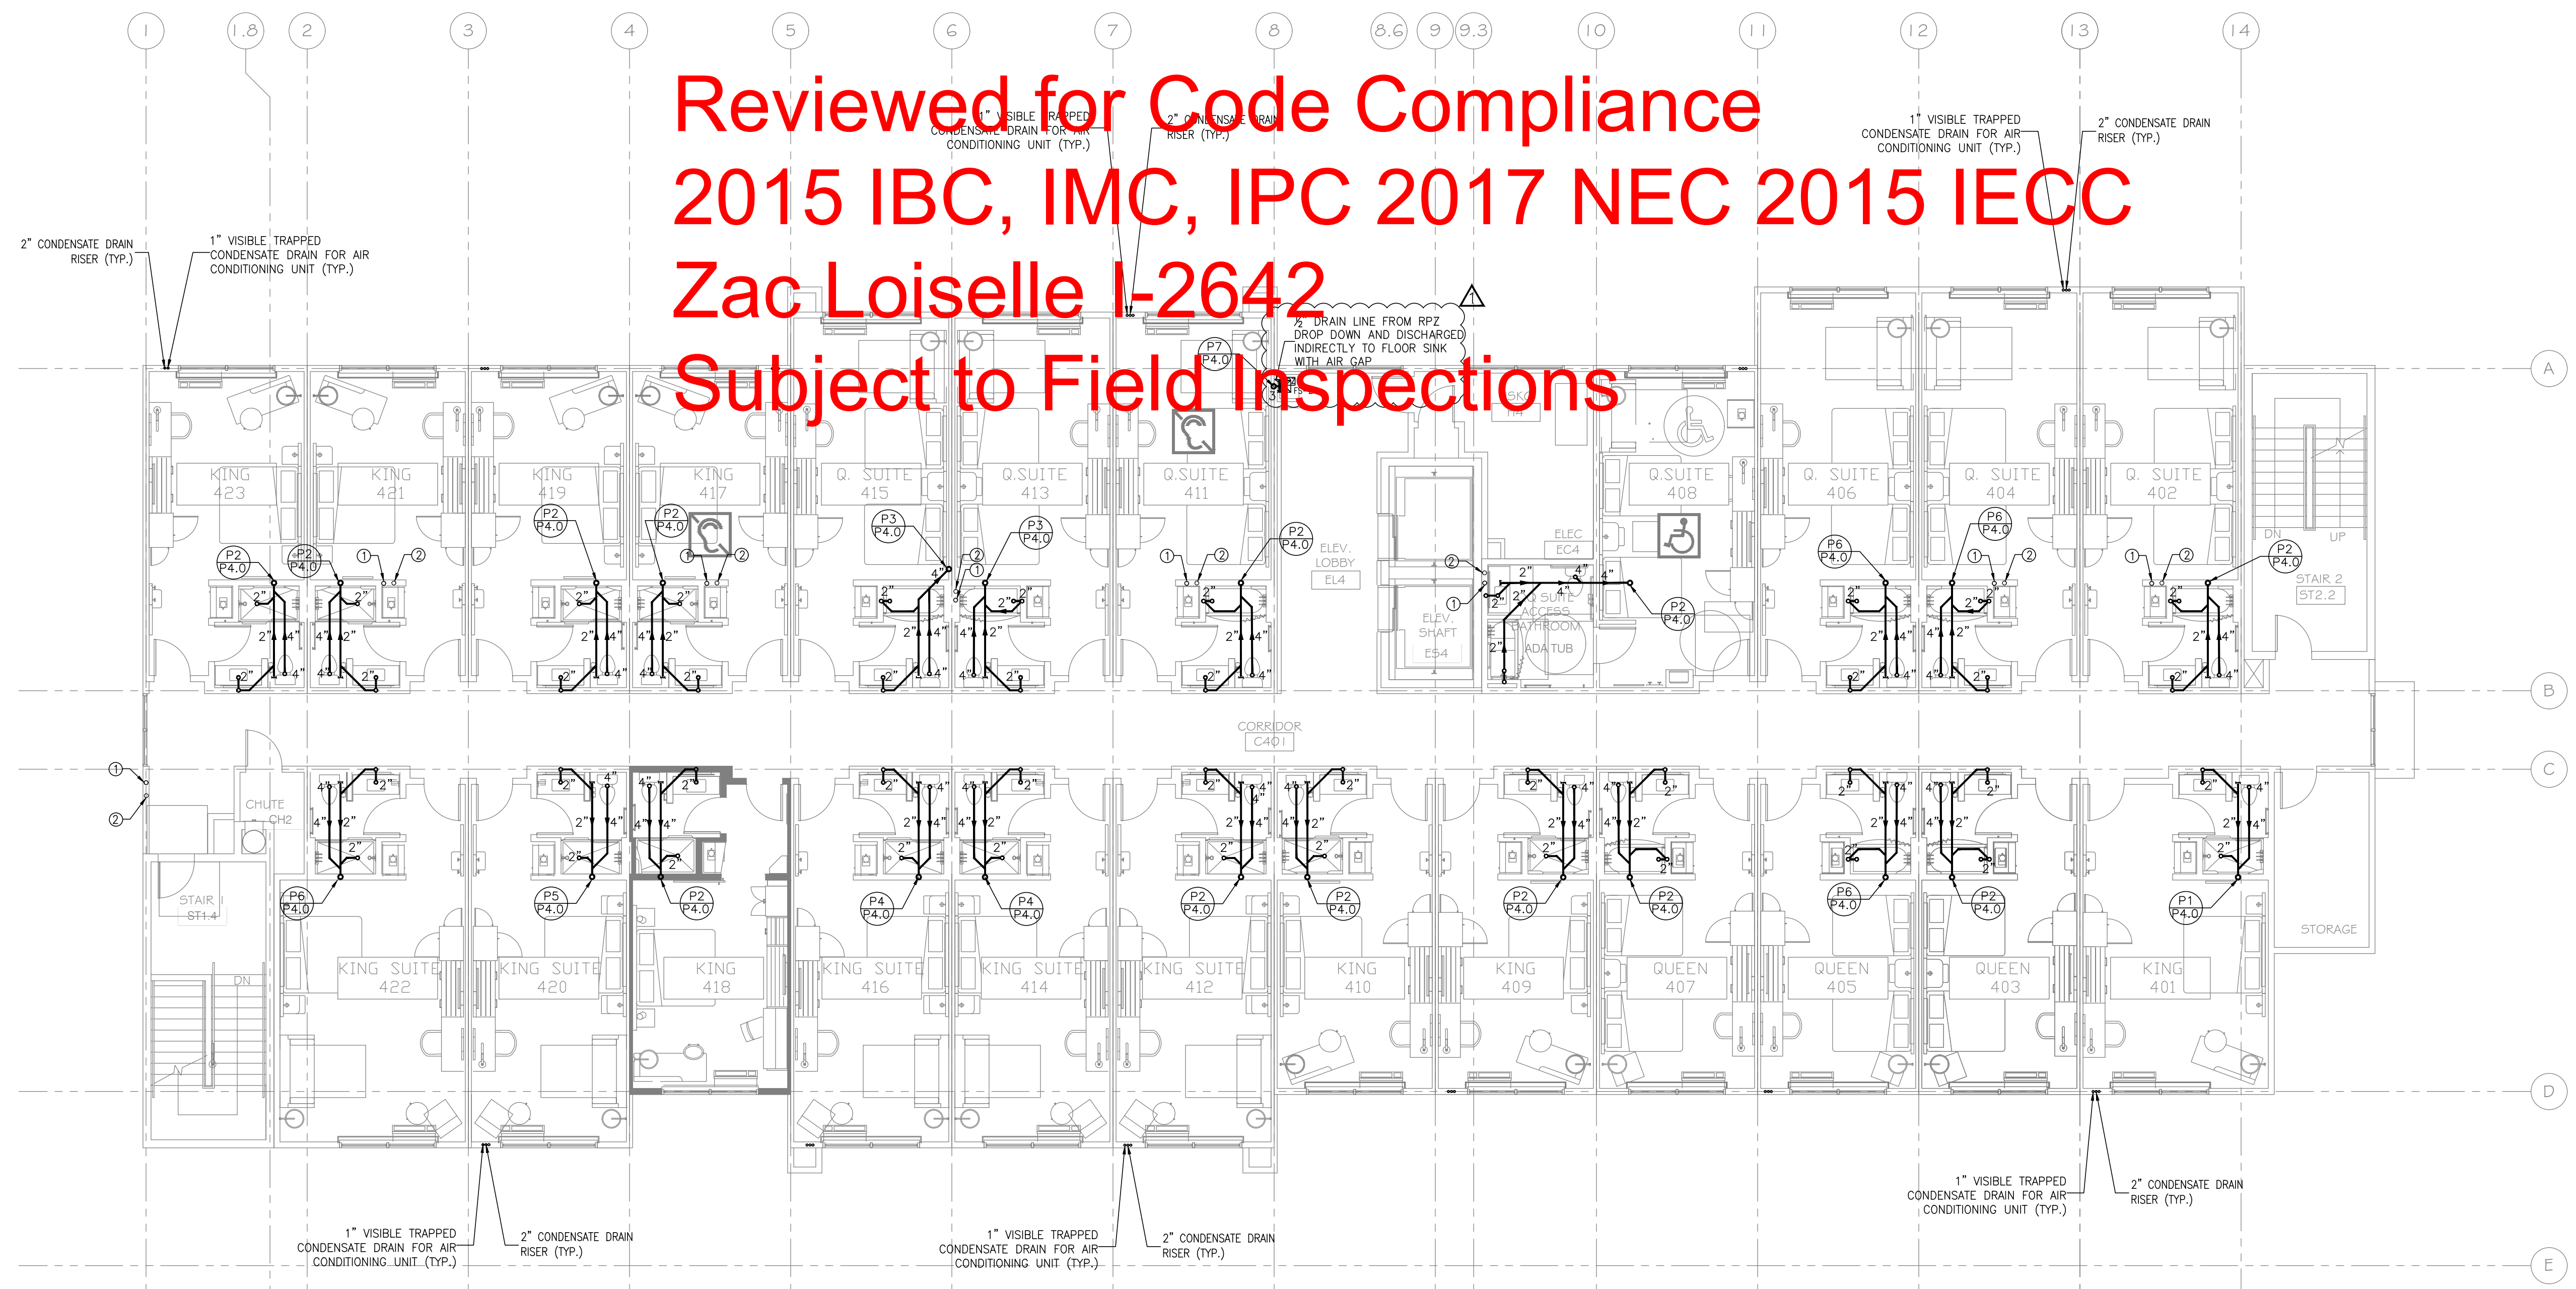

1 SANITARY SEWER
 FOURTH FLOOR PLAN
 SCALE: 1/8"=1'-0"

KEYED NOTES:
 ① 4" ROOF DRAIN RISER
 ② 4" OVERFLOW DRAIN RISER

- NOTES:**
- FOR GENERAL NOTES, PLUMBING FIXTURES AND SPECIFICATIONS, SEE PLUMBING DRAWING P1.0 & P1.1.
 - FOR DRAWING CLARITY, SEE THE VENT PIPING WITH SIZING ON RISER DIAGRAM P4.0, P4.1.
 - ALL PENETRATIONS THROUGH FIRE WALL MUST BE SEALED TO MEET THE CRITERIA.
 - FOR SCHEMATIC DIAGRAMS SEE PLUMBING DRAWING P4.0, P4.1.
 - FOR GAS SCHEMATIC DIAGRAM SEE PLUMBING DRAWING P1.1.
 - ALL FLOOR DRAINS TO BE INSTALLED W/TRAP PRIMERS.
 - PROVIDE DRAIN & VENT FOR SWIMMING POOL PER RECOMMENDATION OF POOL EQUIPMENT SUPPLIER.
 - CONTRACTOR TO SUPPLY THE TEMPERED WATER LIMITING DEVICE FOR WATER HEATER SYSTEM.
 - VACUUM RELIEF VALVE INSTALLED IN THE COLD WATER SUPPLY LINE ABOVE THE TOP OF THE HEATER OR TANK, SHALL BE PROVIDED TO PREVENT SIPHONING OF ANY STORAGE WATER HEATER OR TANK.
 - DISCHARGE POOL, BACKWASH AND SCUM GUTTERS DRAIN TO SANITARY SEWER FOR POOL DRAINAGE SYSTEM.
 - HAND AND CONDENSATE WILL NOT ENTER GREASE INTERCEPTOR.
 - DRAIN SIZES FROM PLUMBING FIXTURES SHALL BE AS FOLLOWS:
 WATER CLOSETS - 4"
 BATHTUB - 2"
 LAVATORY - 2"
 FLOOR DRAIN IN GUESTROOMS - 2"
 FLOOR DRAIN IN PUBLIC AREAS - 3"
 FLOOR SINK - 3"

1. THE PLUMBING CONTRACTOR MUST PREPARE SHOP DRAWING TO COORDINATE WITH STRUCTURAL ENGINEER BEFORE INSTALLING AND GUARANTEE THE WATER, SEWER AND STORM LINE DO NOT RUNNING ALONG WITH THE GRADE BEAMS.
 2. THE CONTRACTOR MUST PERFORM THE COLD/HOT WATER BALANCING TO ENSURE SUFFICIENT HOT WATER THAT DELIVERS TO EVERY GUESTROOM UNIT BEFORE CEILING TILE IS INSTALLED

MEP GREEN DESIGN & BUILD, P.L.L.C. RETAINS COPYRIGHT TO THIS DOCUMENT. THE IDEA DESIGN AND DETAILS, AS A PROFESSIONAL AND INTELLECTUAL INSTRUMENT OF SERVICE, AND IS NOT TO BE USED/COPIED IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE EXPRESSED WRITTEN CONSENT OF MEP GREEN DESIGN & BUILD, P.L.L.C.